




MUNICIPALITY OF POWASSAN CULVERT INSTALLATION

Culvert must be steel or double wall plastic culvert. The culvert must be new.

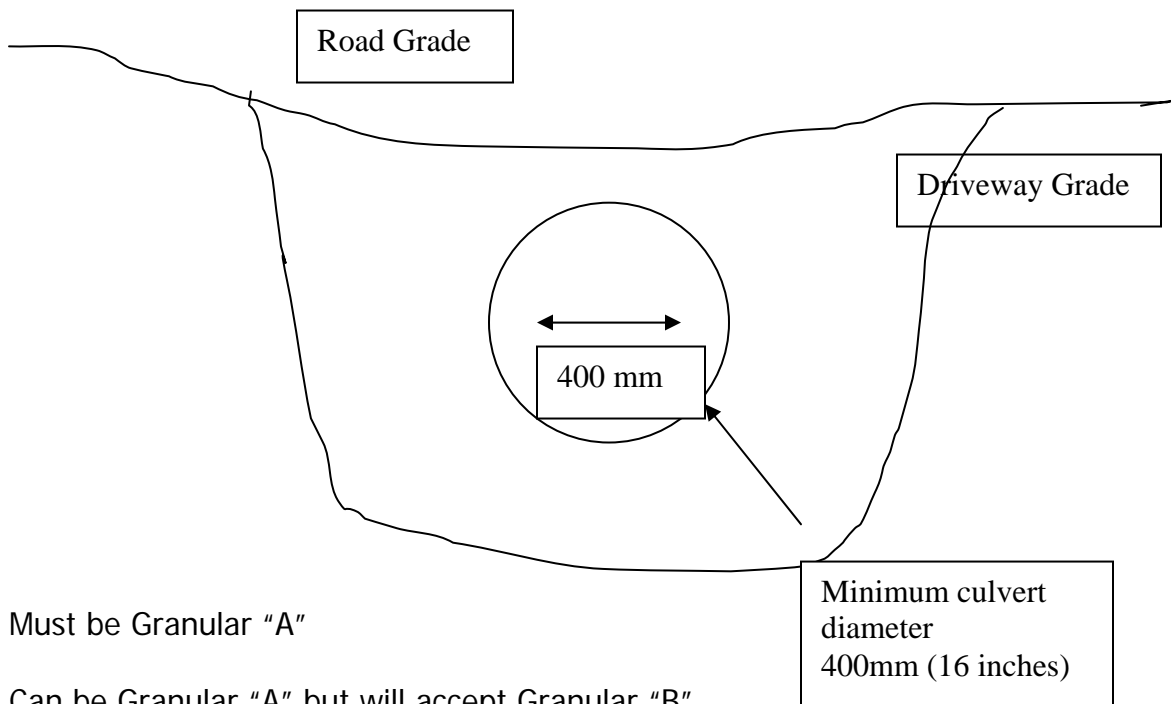

1. Must be minimum of 300 mm all around pipe including underneath in order to prevent frost action.
2. Minimum of 150 mm (6 inches) Granular "A" above pipe.
3. NO cement is allowed at the ends of culverts. The culvert must be exposed a minimum of 300 mm (1 foot) at both ends.
4. Driveway must slope centre line of ditch and not be higher than grade of road where they meet as this will result in damage to driveway during grading operations. Municipality will NOT assume responsibility for damage caused as a result of this.
5. All new or altered entrances must have signed installation acceptance before acceptance will be issued by the Municipality.
6. All lengthening of existing culverts must be installed at same standards as a new entrance.
7. All driveways that will be paved must also have municipal approval before any paving occurs.
8. Secondary driveways must have a minimum distance of separation of 8 metres (26 feet).